

Definition of the constraints

Since human thermal comfort is strongly related to the building, the thermal comfort requirement is generally considered as a major constraint of the optimization of the building problem. The constraints of comfort are given by the following equation (1):

$$T^{min} \leq T^{int} = f(E x_i) \leq T^{max} \tag{1}$$

$T^{int} = f(E x_i)$: Interior temperature of the room, which can be obtained by solving the system of differential equations [20] given by equations (2) and (3):

$$\frac{dT_m}{dt} = \frac{I_s}{C_m} + \frac{T_{int}}{R_m C_m} + \frac{T_{ext}}{R_m C_m} - \frac{2T_m}{R_m C_m} \tag{2}$$

$$\frac{dT_{inst}}{dt} = \frac{I_{inst}}{C_0} - \frac{I_{ac} S(t)}{C_0} + \frac{T_{ext}}{R_f C_0} + \frac{T_m}{R_m C_0} - \frac{T_{int}}{C_0} \left(\frac{1}{R_m} + \frac{1}{R_f} \right) \tag{3}$$

Where:

T_m : Wall temperature in [°C]

T_{ext} : Exterior temperature in [°C]

R_m, C_m : The equivalent thermal resistance in [°C/W] and thermal storage capacity of the room (wall, base and roof) in [J/°C].

S_1 : The equivalent thermal resistance of the average air infiltration [°C/W]

&: Air thermal capacity inside the room [J/°C].

I_s : The current source of the solar radiation and the portion of internal heat sources involved in this indirect heating of air [W].

I_{inst} : The current source (heat source) produced by computer, lamp, etc. [W].

I_{ac} : Extracted heat by air conditioner in [W].

$x(t)$: The switching function.

The values of model parameters are listed in Table .1

Table 1. The parameters of model [20].

Model parameters	Values
C_m	6000000 J/°C
C_0	118235.4 J/K°
R_f	0.01 °C/W
R_m	0.004 °C/W

Problem formulation

Mathematically, the problem of the optimization is formulated as follows:

$$\underset{x_i \in \{0,1\}}{\text{Min}} \left(\sum_{i=1}^D E x_i \right)$$

Such That the constraint:

$$20^\circ\text{C} \leq T^{int} \leq 22^\circ\text{C}$$

Is satisfied.

Optimization results

This is a non-linear optimization problem. The matlab **dsolve** function was used to determine the temperature T^{int} by solving the system of differential equations (equation 1 and 2), and then to check the satisfaction of the comfort constraint:

If: $T^{int} \leq 22^\circ\text{C}$ then $x_i = 0$ consequently the compressor motor of air conditioning is OFF.

Otherwise $T^{int} > 22^\circ\text{C}$, $x_i = 1$ therefore the air conditioning is ON.

This make it possible to considerably minimize the running time of the air conditioner and consequently the electrical energy consumed .Indeed before optimization the total consumption of the house in the day of July 6, 2016 reaches to 94.11 KWh. However, after optimization, the obtained results are summarized in Table 2.

Table 2. Optimized energy consumptions.

The operating time of the air conditioner	3 h
The electrical consumption of other loads	55.111kWh
The electrical consumption of the air conditioner	15 kWh
Total consumption of the house	70.111kWh

By this optimization, we were able to reduce the energy consumed from 94.11 kWh to 70.111 kWh by saving 25.5% of the energy consumed during 24 hours.

AIR CONDITIONING REGULATOR SYSTEM

Description of the air conditioning regulator system

In this paper, the model under study is an air conditioning system (Figure 3) consisting of three parts. First a model of an air conditioned room operated by electric power circuit voltage (220 V). Secondly, a control system contains two thermocouples sensors, fed by a voltage control circuit (12 V).Thirdly an automatic regulation system.

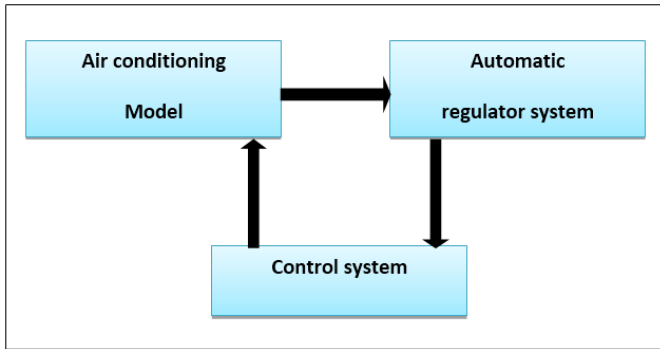


Figure 3. Air conditioning regulator system.

In the first part of the system, the model of an air conditioned room is modeled [20]. It's implemented as blocks in the MATLAB/Simulink environment. The obtained Simulink model is used to provide thermal comfort room and power consumption of the air conditioner; therefore it is necessary to set another command system for controlling the operation of

the air conditioner. The command system consists of the set of two thermocouples to maintain the atmosphere of the room around the two temperatures T-set 1 and T-set 2, a 12 V relay to ensure the opening and closing of two thermocouples and a battery with 12 V voltage source to power all of the control part.

The third part of an automatic control system is used to act on the operation of the difference between the total power and the permissible power to ensure comfort while limiting the consumption peak at a preset level.

Implantation of air conditioning regulator system

An air conditioning system schematic's is shown in Figure 5. The air conditioning system is combined of three parts implemented in MATLAB/Simulink environment: air conditioning model, control system and regulation system.

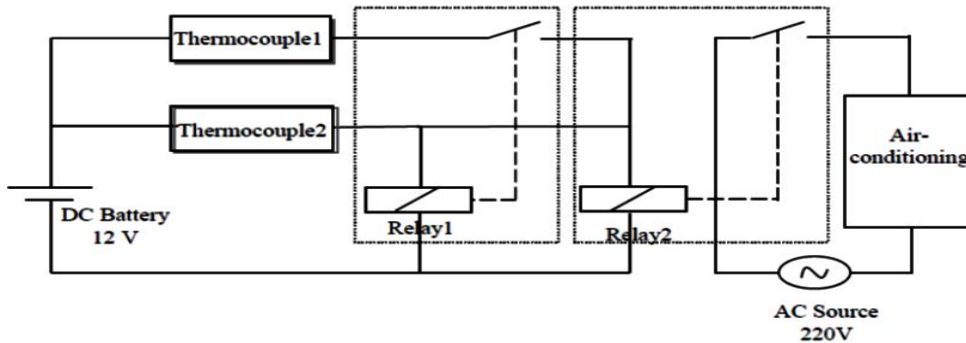


Figure 4. Electrical analogue model for air-conditioned regulator system.

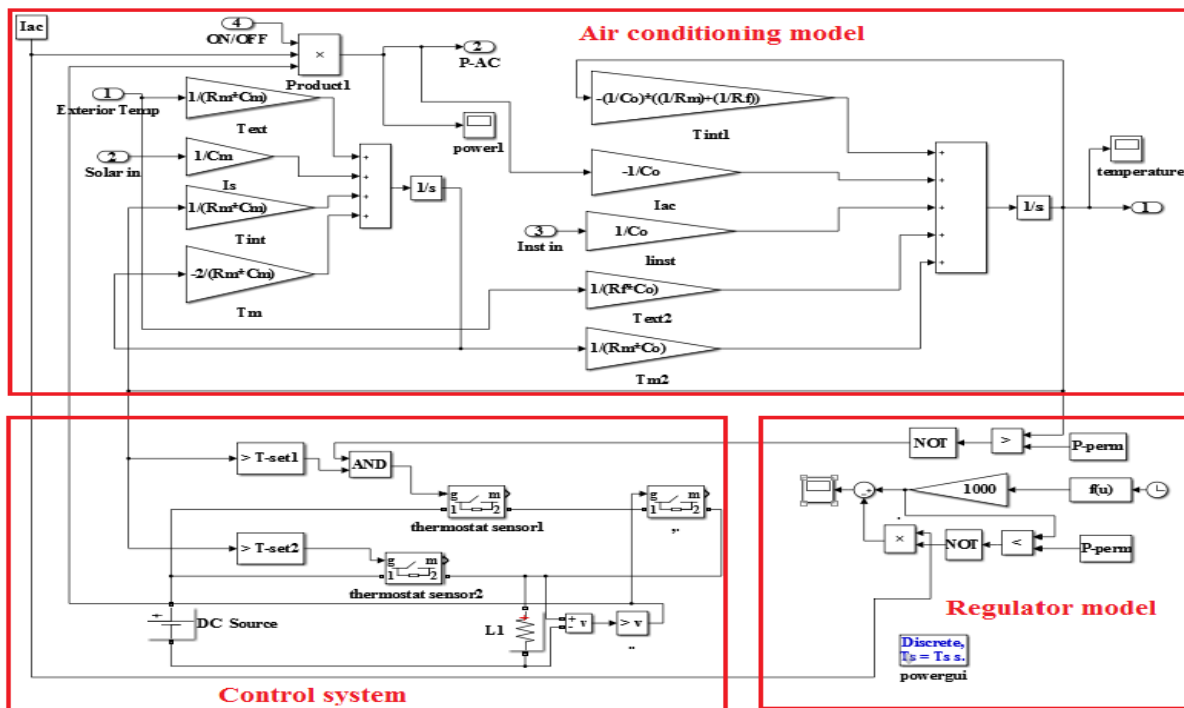


Figure 5. Model of the air conditioning regulator system in MATLAB/ Simulink

Simulation results

The simulation is done by setting temperature of the room equal to 20 ° C ,the exterior temperature is mentioned in the Figure 5, Simulation is run for 24 hours (from 0 h to 24 h=86400 s).

The permissible power is fixed: 6 kW

From Fig.6 we can see that the electric power consumed in the interval of 14-18 hours is much higher relatively to the other time of day due to the use of air conditioning.

In the normal operation

Figure 7 shows the total power of the house during 24 h. In Figure 8 the temperature of the room using air conditioner, while Figure 9 shows the operation power of the air conditioning. Likewise, we can also observe that in the normal operation, the total consumption of the house reaches 94.11 kWh per day.

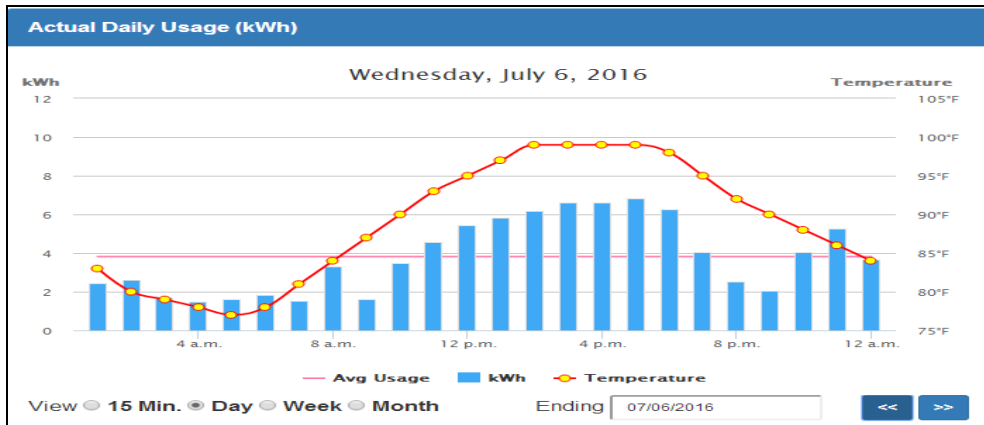


Figure 6. Exterior temperature and the power demand curve for July 6, 2016.

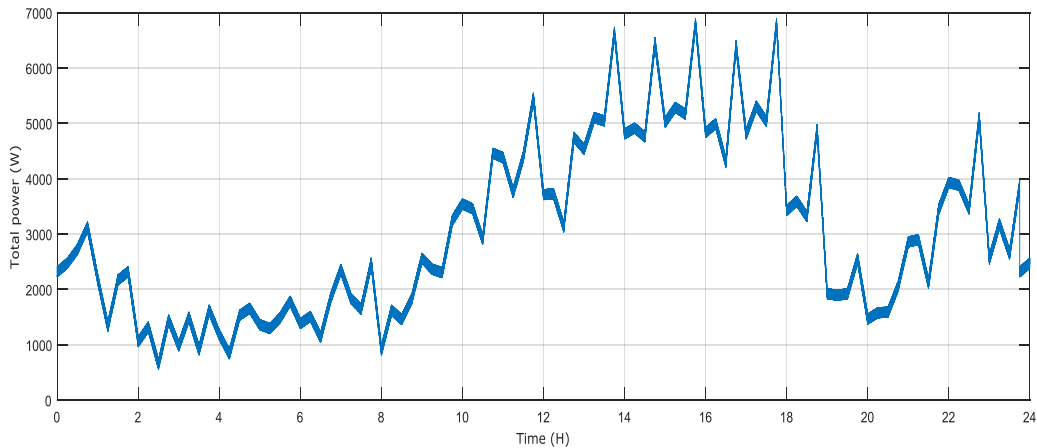


Figure 7. Total power of the house

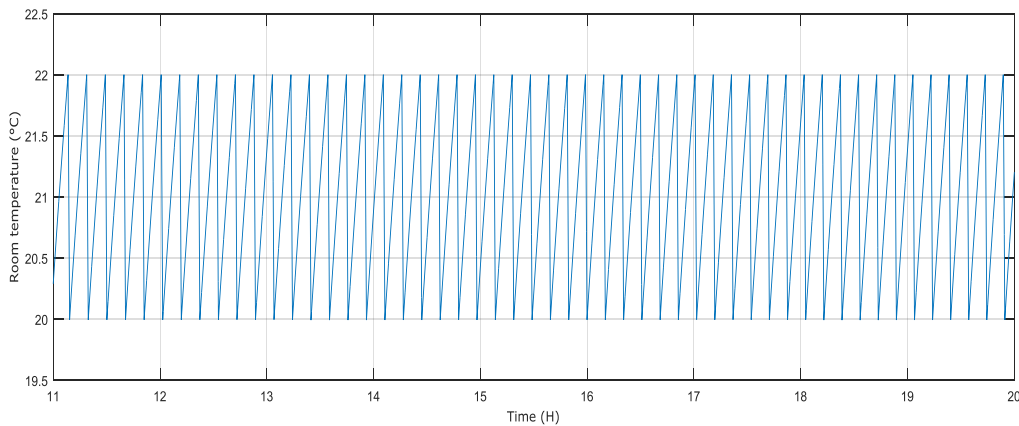


Figure 8. Interior temperature of the room.

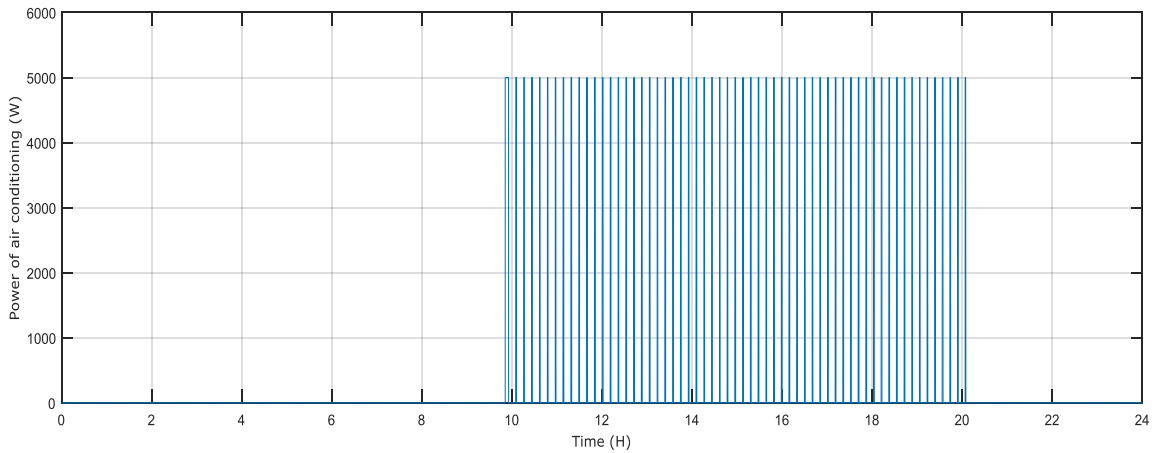


Figure 9. Power of the air conditioning motor.

Figure 7 shows the power consumption the 06th day of July 2016. There are 5 peaks greater than the permissible power that are: 6.65 kW, 6.46 kW, 6.81 kW, 6.41 kW, and 6.81 kW.

For the interior temperature of the room; Figure 8 when the air conditioner is on (from 11am to 9pm) the temperature is always between 20 °C and 22 °C so the thermal comfort is maintained.

Figure 9 illustrate that the air conditioning cycle works during the high temperature (11am to 9pm) and it is usually off in the

early morning and night hours when the temperature is low.

With use of air conditioning regulator system

Figure 10 shows the total power of the house during 24 h, where as temperature of the room using air conditioner is shown in Figure 11 and Figure 13: the operational power of the air conditioning is represented when the regulator system is functioning.

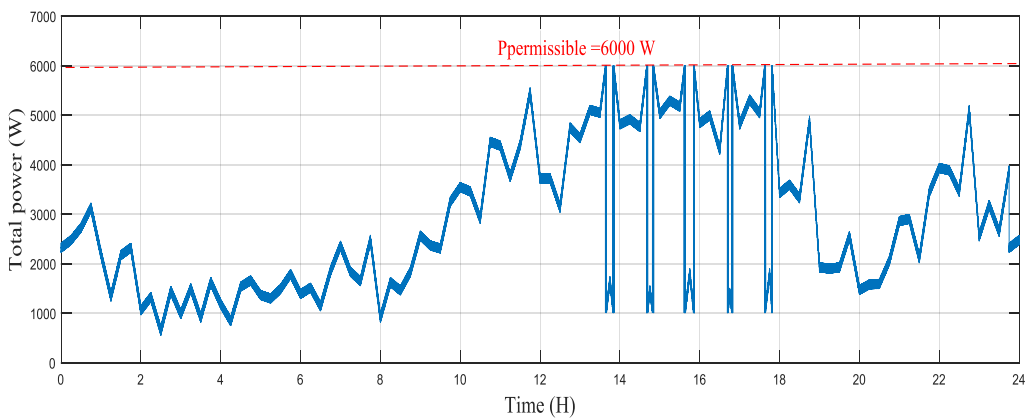


Figure 10. Total power of the house.

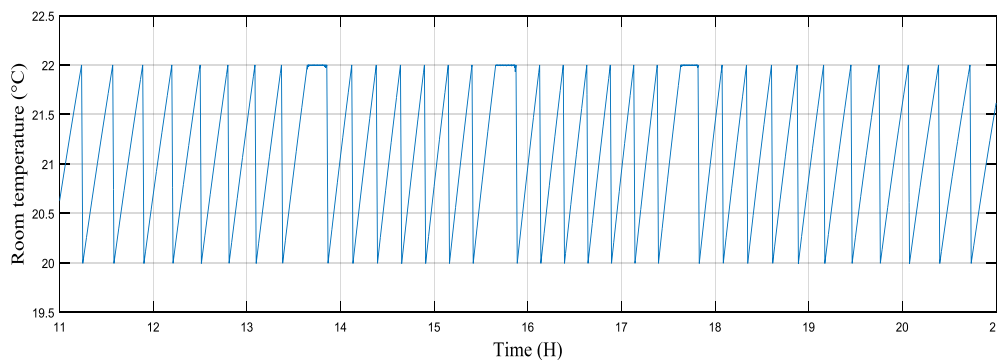


Figure 11. Interior temperature of the room.

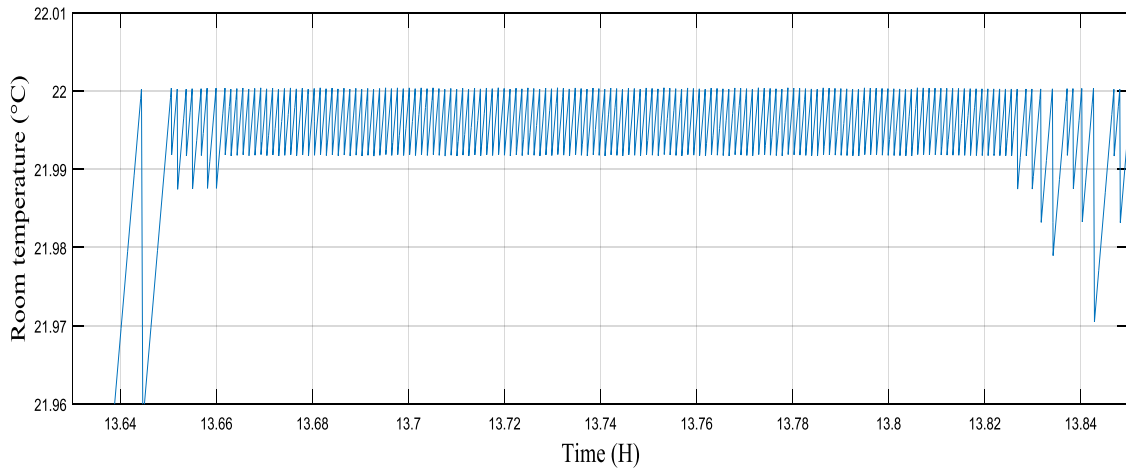


Figure 12. Interior temperature of the room (zoom).

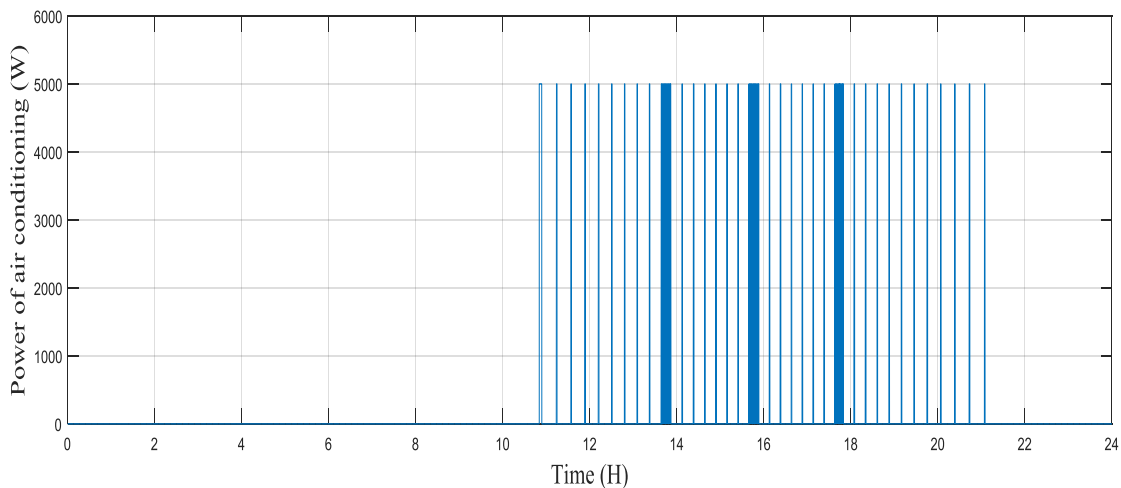


Figure 13. Power of the air conditioning motor.

It can be seen that:

- The peak loads are totally eliminated (Figure 10).
- The temperature (Figure 11) is always less than 22 ° C. therefore the thermal comfort is maintained.

We can say that during the use of our air conditioning:

- The regulator system allows to reducing the total consumption from 94.11kWh to 83.048 kWh (around 9% of the total consumption) and this when we apply air conditioning system for a single room only.
- The peak load is reduced because the power is always inferior to the fixed permissible power 6 kW.
- The thermal comfort is maintained because the temperature varied but always lower than the maximum $T=22^{\circ}\text{C}$.

CONCLUSION

Through this research, two methods have been used, the first one represents an optimization method applied for a house, the decrease of daily consumption is evaluated; the second method represents the development of an air conditioning system. Such system consists of three parts: the first part is the model of the air-conditioned room, the second one is control system based on thermocouples; the third and last part is a regulation system constrained by the value of permissible power. The key idea of the proposed system is based on efficient reduction of the total electrical consumption without sacrificing the thermal comfort of occupants.

The optimal method aims to minimize the functioning time of the air conditioner. According to the results, it is possible to save around 25 % from the total consumption in one day.

The simulation results show that the air conditioning system can significantly save energy and maintain thermal comfort as well. Thus, this method can be adapted for all the houses or buildings.

REFERENCES

- [1] Seyboth, K; and Beurskens, L; and Langniss, O; 2008, "Recognizing the Potential for Renewable Energy Heating and Cooling," *Energy Policy*.; 36: 2460-2463.
- [2] Kalkan, N; and Young, E.A; and Celiktas ,A; 2012, "Solar Thermal Air Conditioning Technology Reducing the Footprint of Solar Thermal Air Conditioning," *Renew.Sustain.Energy*; 16: 6352-6383.
- [3] Ding, Y; and Tian, Z; and Wu, Y; and Zhu, N; 2011, "Achievements and Suggestions of Heat Metering and Energy Efficiency Retrofit for Existing Residential Buildings in nor them Heating Regions of China, " *Energy Policy*; 39: 4675-4682.
- [4] Nasution, H; and Sumeru, K; and Aziz, A.A; and Senawi, M.Y; 2014,"Experimental Study of Air Condition Control System for Building Energy Saving," *Proc. 6th international conference, Applied Energy*; 61: 63-66.
- [5] Allali, K; and Azzag, E; 2015, "Labar H. Techno-Economic Analysis of a Wind Diesel Hybrid Power System in the South Algeria, " *International journal of renewable energy development*; 137-142.
- [6] Tekla, S.S; 2017, "The Effects of Utility Cost Reduction on Residential Energy Consumption in Hungary-a Decomposition Analysis," *International Journal of Sustainable Energy Planning and Management*; 61-78.
- [7] Tuan, Y. K; and Gao, P; and Wang, J.A; 2010, "Hybrid Decision Support System for Sustainable Office Building," *Energy Build*; 42: 290-297.
- [8] Manewan, S; and Tipsaenprom, W; and Lertsatitthanakorn, C; 2010, "Thermal Comfort Study of a Compact Thermoelectric Air Conditioner," *Journal of electronic materials*; 39-9.
- [9] Sayadi, Z; and El May, S; and Bourouis, M; and Bellagi, A; 2013, "Technical and Economic Analysis of a Solar Assisted Air Conditioning System," *International Journal of Renewable Energy Technology*; pp. 65-85.
- [10] Kandemir, E; and Borkci, S; and Sabit Cetin, N.A; 2017, "Comparative analysis of MPPT Methods Using Reduced Rule Compressed Fuzzy Logic Control and Incremental Conductance Method," *Proc. 5th European Conference on Renewable Energy Systems, Istanbul, Turkey*.
- [11] Ugurlu, A; and Gokcol, C. A; 2017, "Renewable Based Hybrid System for a Mountain House in Sakarya," *Proc. 5th European Conference on Renewable Energy Systems, Istanbul, Turkey*.
- [12] Naciri, M; and Aggour, M; and Ait Ahmed, W; 2017, "Wind Energy Storage by Pumped Hydro Station," *Journal of Energy Systems*; 1(1), 32-42.
- [13] Le, K; and Quoc, T; and Sabonnadière, J.C; and Kieny, C; and Hadjsaid, N; 2007, "Peak Load Reduction by Using Heating Regulators Technical Impacts of Small Distributed Generation units on LV Networks," *CIRED; Vienna* 21-24.
- [14] Al. Sanea, S. A; and Zedan, M.; 2011, "Improving Thermal Performance of Building Walls by Optimizing Insulation Layer Distribution and Thickness for Same Thermal Mass," *Appl Energy*; 88: 3113-24.
- [15] Al. Sanea, S. A; and Zedan, M; 2008, "Optimized Monthly-Fixed Thermostat-Setting Scheme for Maximum Energy-Savings and Thermal Comfort in Air-Conditioned Spaces," *Appl Energy*; 85: 326-46.
- [16] Al. Sanea, S. A; and Zedan, M.; and Al-Ajlan, S.A; and Abdu-Hadi, A; 2003, "Heat Transfer Characteristics and Optimal Insulation Thickness for Cavity Walls," *Journal of Thermal Envelope Bldg*; 26(3): 285-307.
- [17] Al. Sanea, S.A; 2003, "Finite-Volume Thermal Analysis of Building Roofs under two-Dimensional Periodic Conditions," *Build. Environ*; 38: 1039-49.
- [18] Braun, J. E; and Montgomery, K; and Chaturvedi, N; 2001, "Evaluating the Performance of Building Thermal Mass Control Strategies," *HVAC & R Res*; 27: 403-28.
- [19] Missaoui, R; and Warkosek, G; and Bacha, S; and Ploix, S; 2012, "Real Time Validation of an Optimization Building Energy Management Strategy based on Power-Hardware in the Loop Tool," *IEEE PES innovation Smart Grid Technologies (ISGT)*.
- [20] Le, K; and Tran-Quoc, T; and Jean-Claude Sabonnadière; and Kieny, Ch; and Hadjsaid, N; 2008 "Peak Load Reduction by Using Air-Conditioning Regulators," *Proc. 14th Electro technical Conference. MELECON*; pp. 713-718. IEEE.
- [21] Riffonneau, Y; and Bacha, S; and Barruel, F; and Delaille, A; 2009, "Energy Flow Management in Grid Connected PV Systems with Storage," *Proc. IEEE international Conference on Industrial Technology*; 6: 10-13.
- [22] Riffonneau, Y; and Bacha, S; and Barruel, F; and Ploix, F; 2011, "Optimal Power Flow Management for Grid Connected PV Systems with Batteries," *IEEE Transactions on Sustainable energy*; 3: 309-320.
- [23] Gendebien, S; and Georges, E; and Bertagnolio, S; and Lemort, V; 2014, "Methodology to Characterize a Residential Building Stock using a bottom-up approach: a case study applied to Belgium," *International Journal of Sustainable Energy Planning and Management*; 71.88.
- [24] Balku, S; and Kocyigit, F; 2016, "Energy Efficient Architectural Design," *Proc. 4th European Conference on Renewable Energy Systems, Istanbul, Turkey*.
- [25] Ben Cheikh, R; and Moulay, D; 2016, "Thermal Performance of Earth Ksourian Houses in Hot arid

Climat, case study Kasar Laghouat," Proc. 4th European Conference on Renewable Energy Systems, Istanbul, Turkey.

- [26] Farah, S; and Whaley, D; and Saman, W; 2016, "Control Strategies of Domestic Electrical Storage for Reducing Electricity Peak Demand and Life Cycle Cost," International Journal of Hydrogen Energy; 20314-20325.